
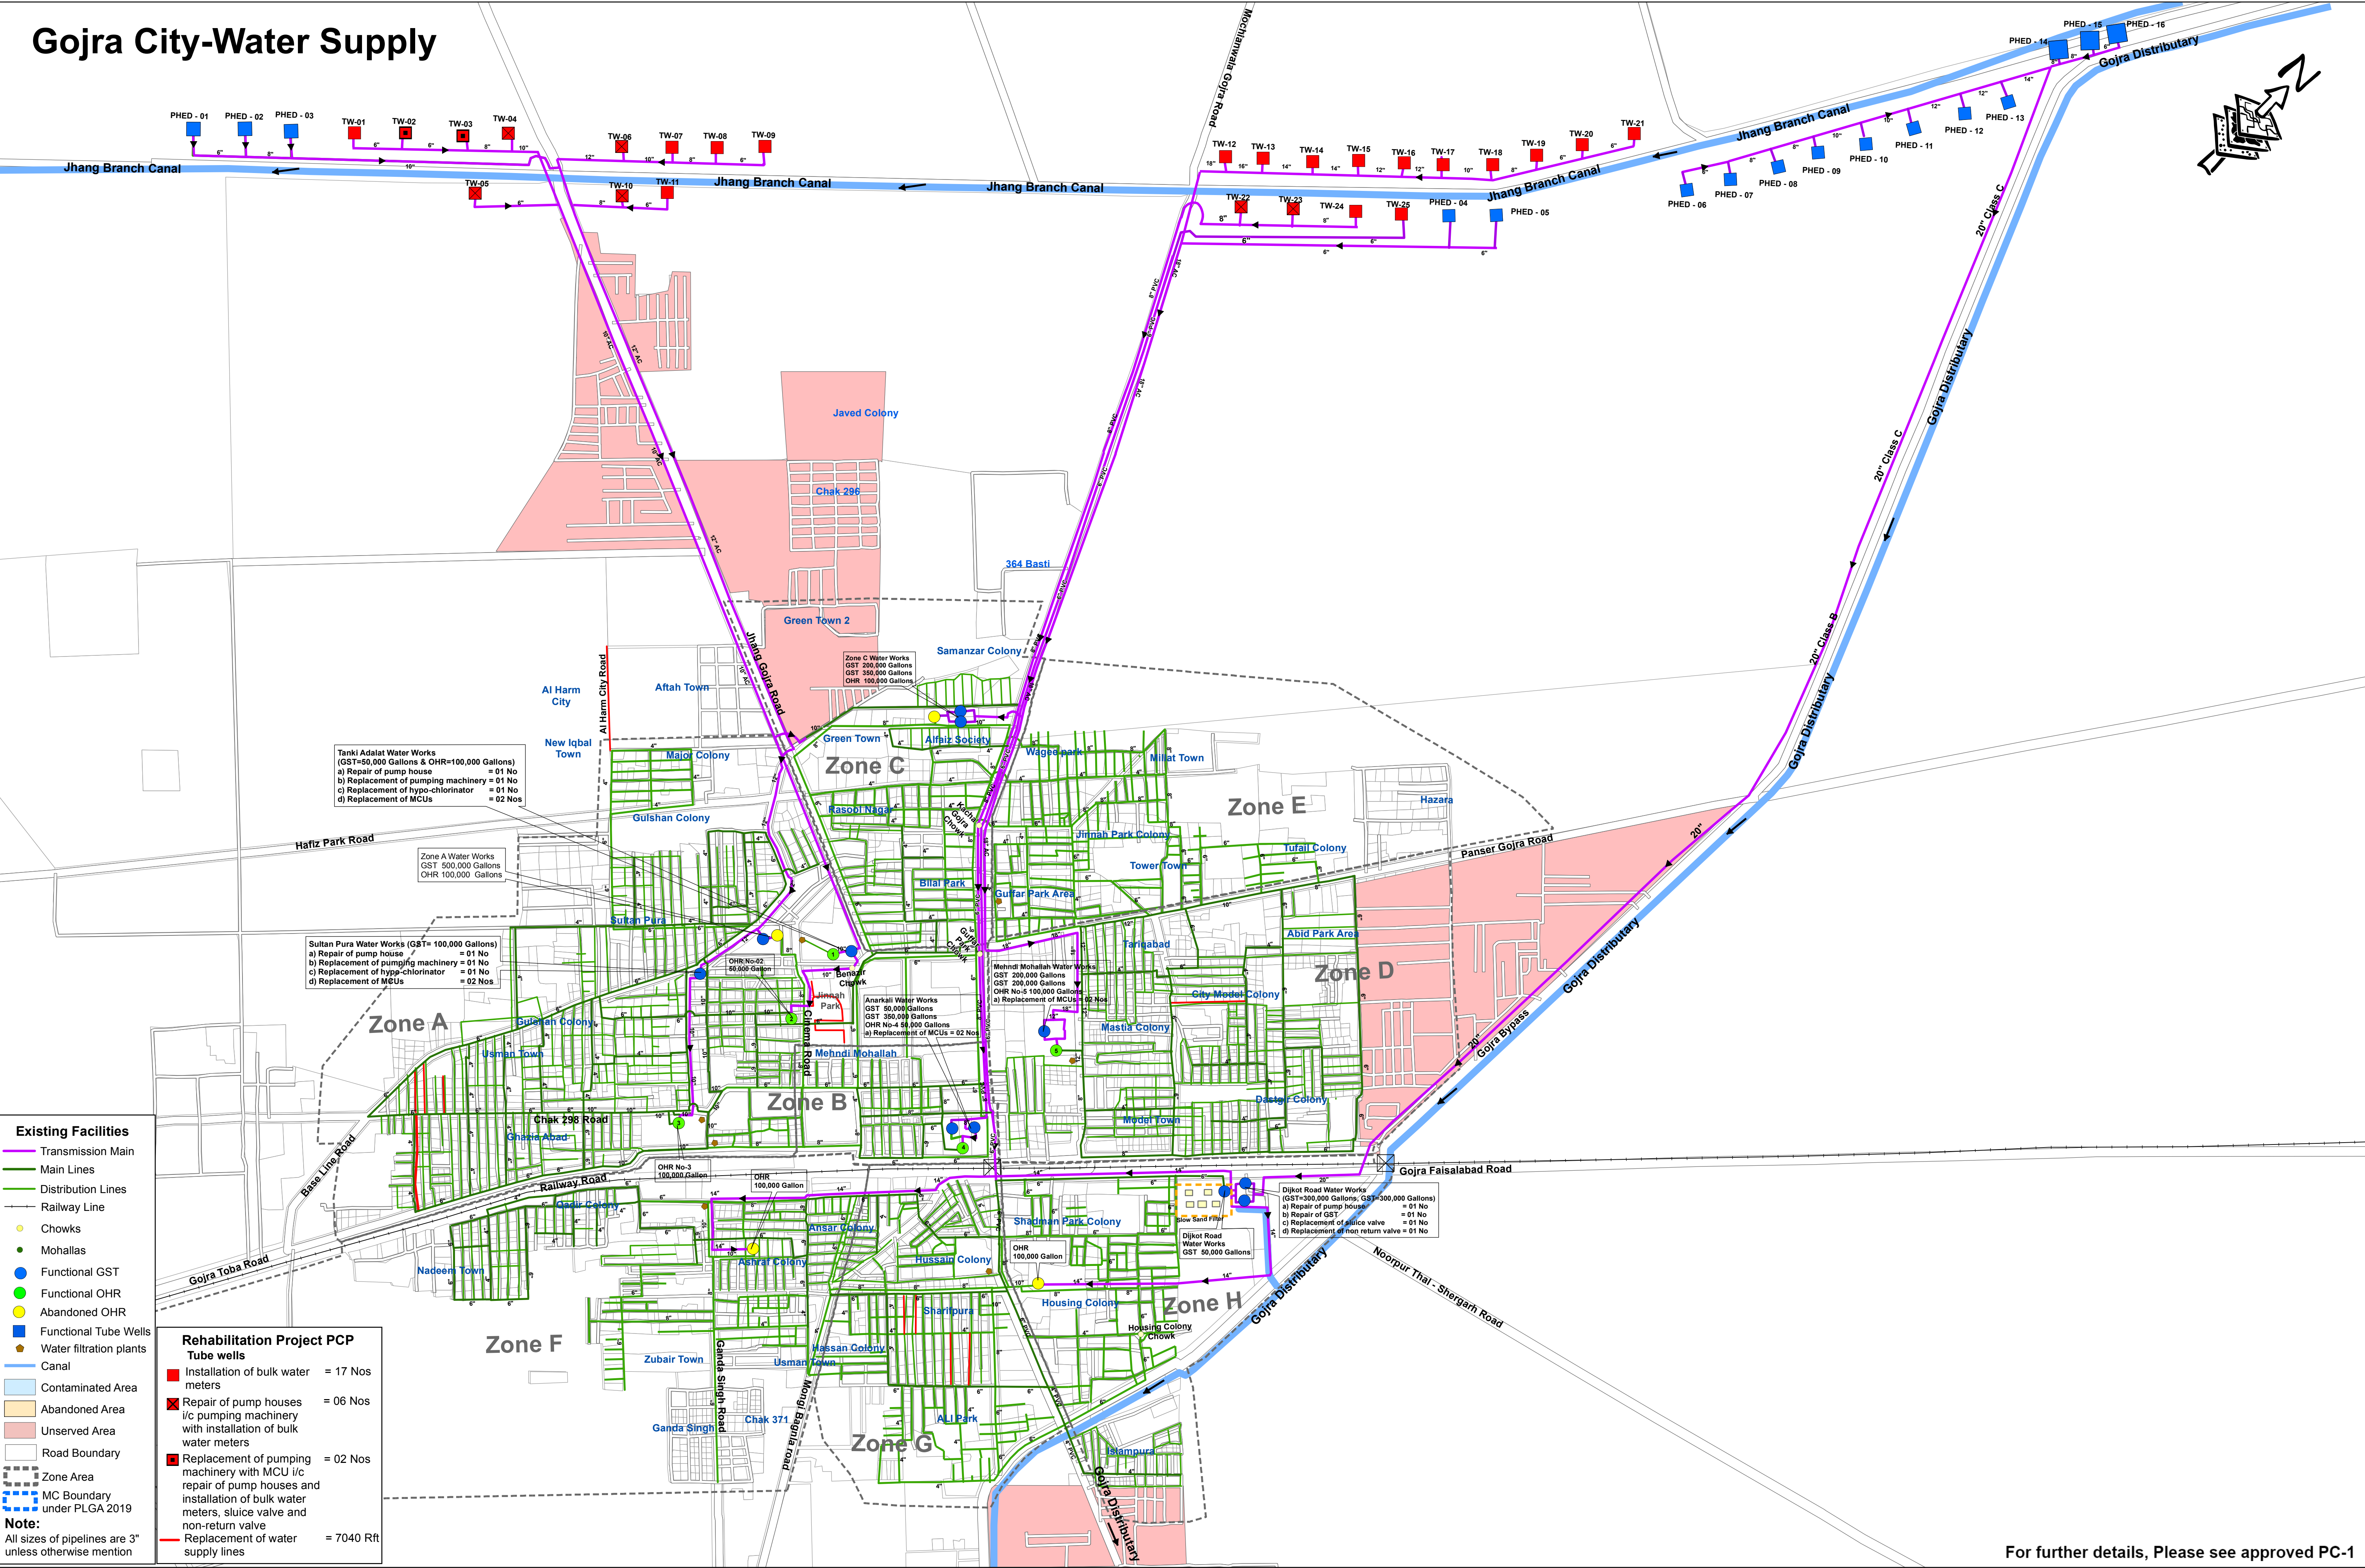


# Gojra City-Water Supply

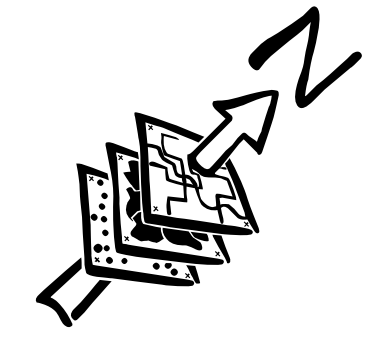

**Tanki Adalat Water Works**  
(GST=50,000 Gallons & OHR=100,000 Gallons)  
a) Repair of pump house = 01 No  
b) Replacement of pumping machinery = 01 No  
c) Replacement of hypo-chlorinator = 01 No  
d) Replacement of MCUs = 02 Nos

**Zone A Water Works**  
GST 500,000 Gallons  
OHR 100,000 Gallons

**Sultan Pura Water Works** (GST= 100,000 Gallons)  
a) Repair of pump house = 01 No  
b) Replacement of pumping machinery = 01 No  
c) Replacement of hypo-chlorinator = 01 No  
d) Replacement of MCUs = 02 Nos

**Anarali Water Works**  
GST 50,000 Gallons  
OHR No-4 50,000 Gallons  
a) Replacement of MCUs = 02 Nos

**Mehndi Mohallah Water Works**  
GST 200,000 Gallons  
OHR No-5 100,000 Gallons  
a) Replacement of MCUs = 02 Nos

**Dijkot Road Water Works**  
(GST=300,000 Gallons, GST=300,000 Gallons)  
a) Repair of pump house = 01 No  
b) Repair of GST = 01 No  
c) Replacement of sluice valve = 01 No  
d) Replacement of non return valve = 01 No

- Existing Facilities**
- Transmission Main
  - Main Lines
  - Distribution Lines
  - Railway Line
  - Chowks
  - Mohallas
  - Functional GST
  - Functional OHR
  - Abandoned OHR
  - Functional Tube Wells
  - Water filtration plants
  - Canal
  - Contaminated Area
  - Abandoned Area
  - Unserved Area
  - Road Boundary
  - Zone Area
  - MC Boundary under PLGA 2019
- Note:**  
All sizes of pipelines are 3" unless otherwise mention

- Rehabilitation Project PCP**
- Tube wells
  - Installation of bulk water meters = 17 Nos
  - Repair of pump houses i/c pumping machinery with installation of bulk water meters = 06 Nos
  - Replacement of pumping machinery with MCU i/c repair of pump houses and installation of bulk water meters, sluice valve and non-return valve = 02 Nos
  - Replacement of water supply lines = 7040 Rft

For further details, Please see approved PC-1